



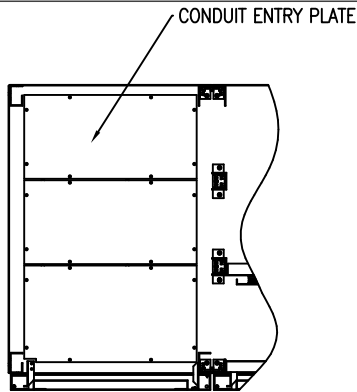

BOTTOM CABLE ENTRY
CROSS SECTION A-A

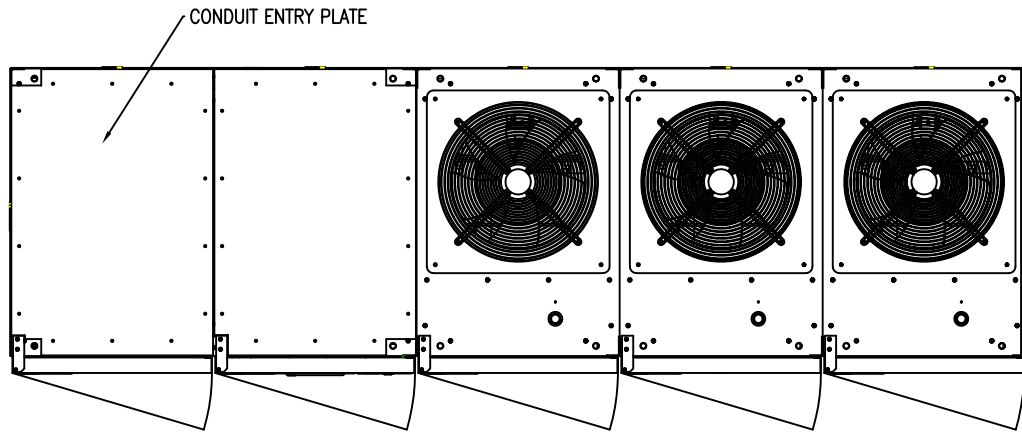


EACH DOOR
R23.2"(590)
88" SWING MAX

TOP VIEW


TYPE: T90S3S01MS6XSN
RATING: 1000kVA, 3 ϕ , 3W, 480V, 60Hz
HEAT REJECTION: 112.8 kBTUs/HOUR

NOTES

1. DIMENSIONS ARE SHOWN IN INCHES" [MILLIMETERS].
2. CABINET MUST BE MAINTAINED UPRIGHT WITHIN $\pm 15^\circ$ DURING HANDLING.
3. EACH BASE HAS 2 or 4 x 0.8" [20] DIAMETER MOUNTING HOLES.

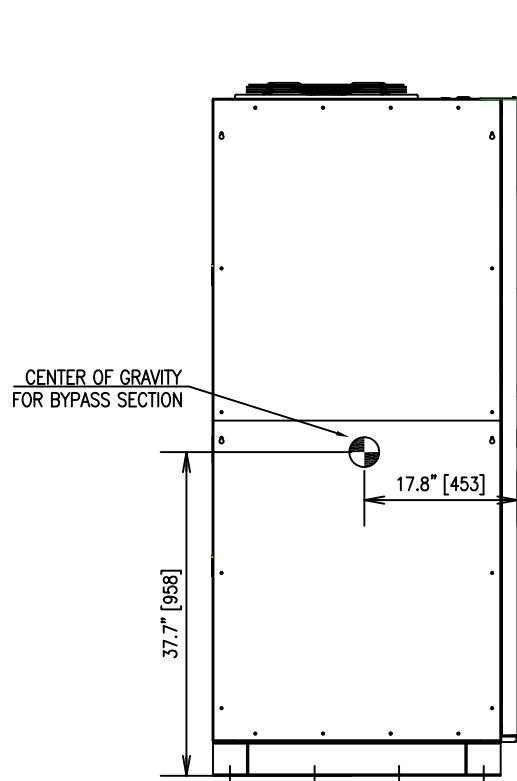


LEFT SIDE VIEW

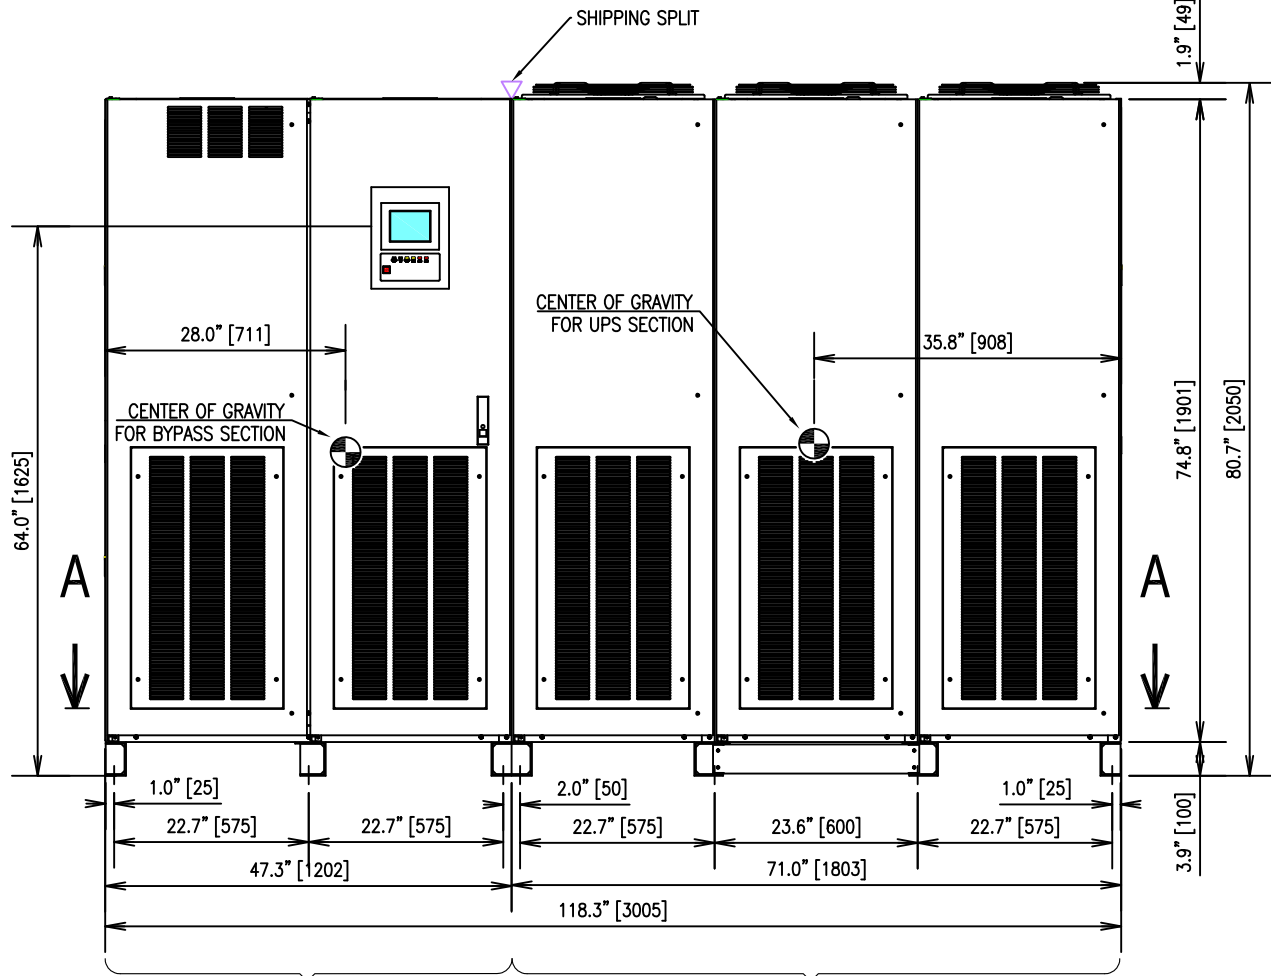

BYPASS SECTION
1653# (750kg)

UPS SECTION
4960# (2250kg)

FRONT VIEW

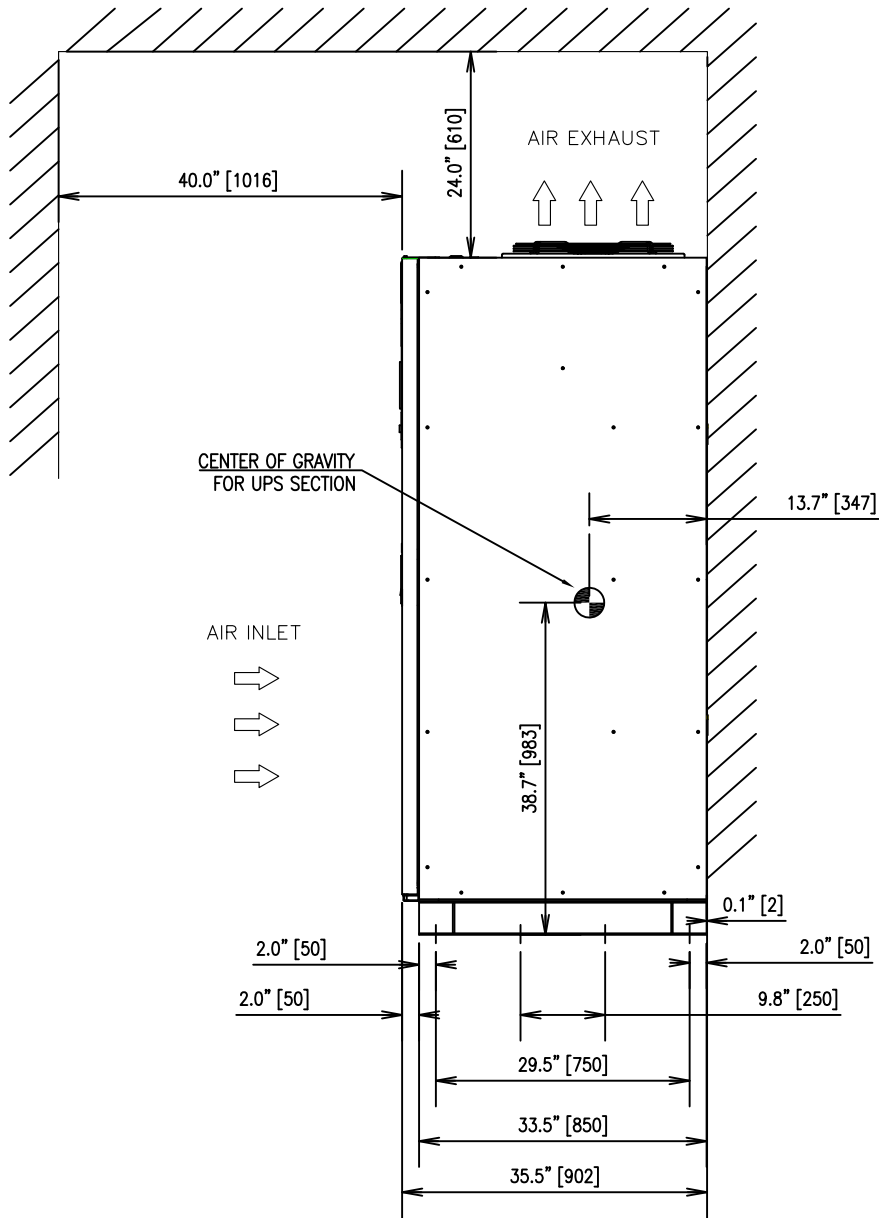

RIGHT SIDE VIEW

FOR QUOTE

Q0

JBT

DRAWN BY:
JBT

DATE
3/20/14

CHECKED BY

DATE

APPROVED BY

DATE

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF
TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT
BE REPRODUCED, USED OR DISCLOSED TO OTHERS
UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.


TITLE: G9000 1000kVA UPS
OUTLINE & INSTALLATION DIAGRAM

SCALE
NTS

ORDER NO.






DRAWING NO.
1M441C14039KJBT-MKTG

TOSHIBA INTERNATIONAL CORPORATION
13131 WEST LITTLE YORK ROAD, HOUSTON, TX, 77041 U.S.A.

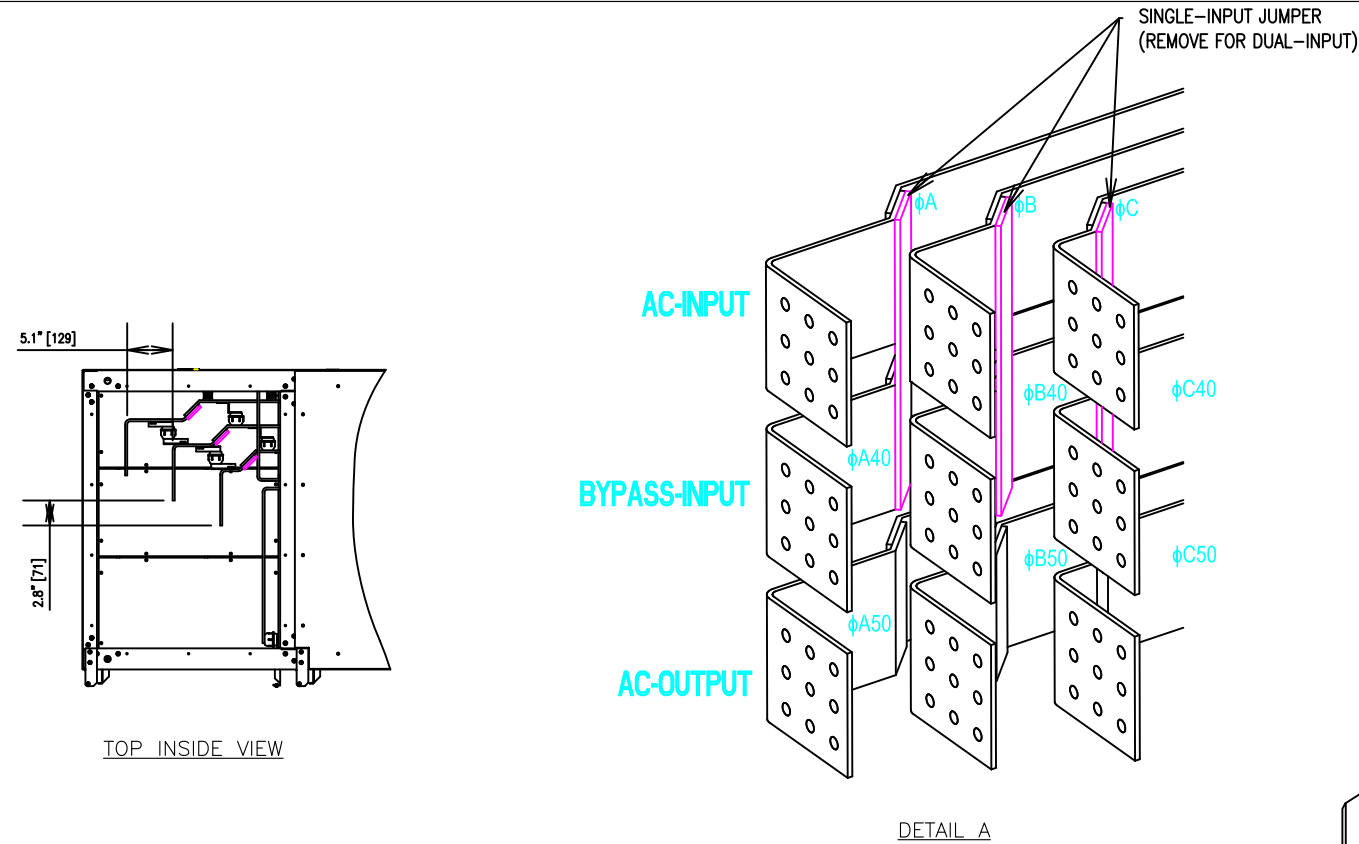

NOTES

- EXTERNAL WIRING TO BE PROVIDED BY CUSTOMER FOR AC-INPUT, DC-INPUT, BYPASS-INPUT, AND AC-OUTPUT.
- PHASE ROTATION IS A, B, C, CLOCKWISE.

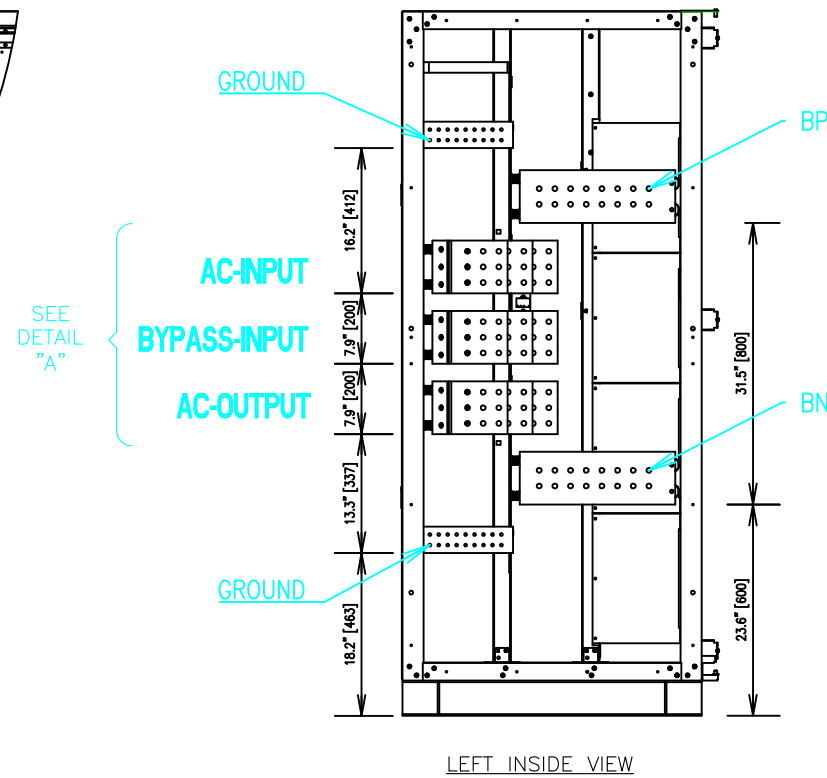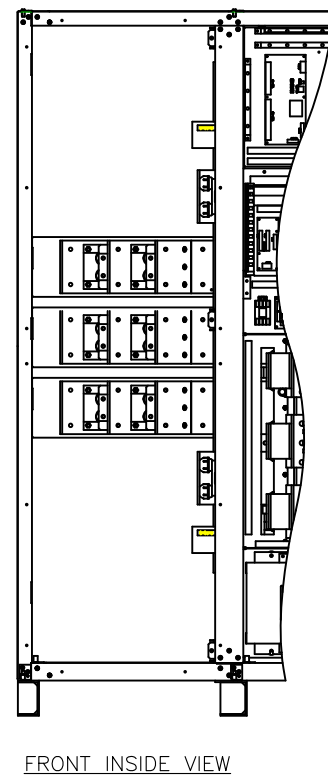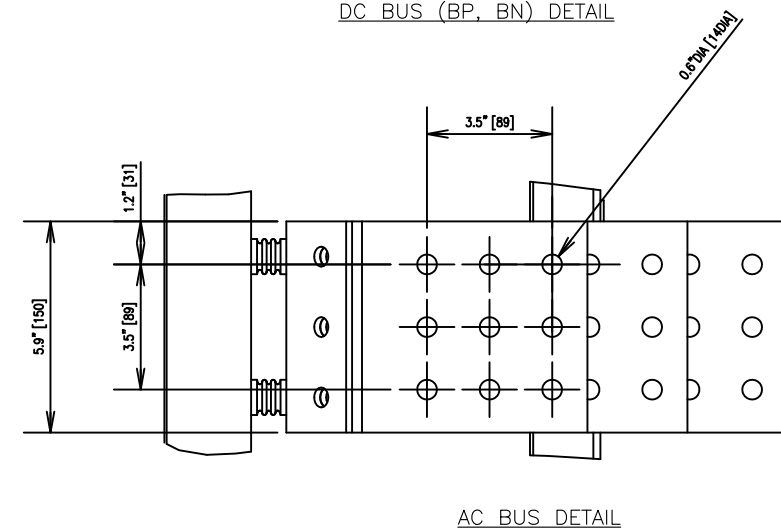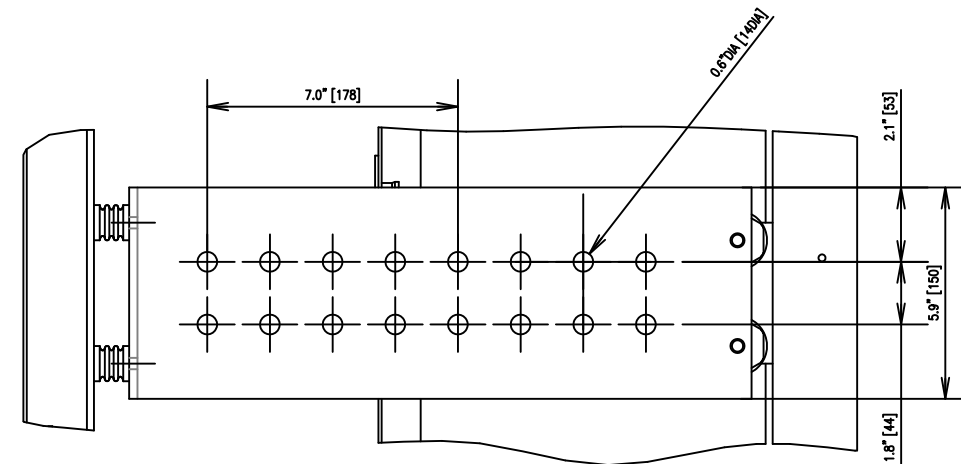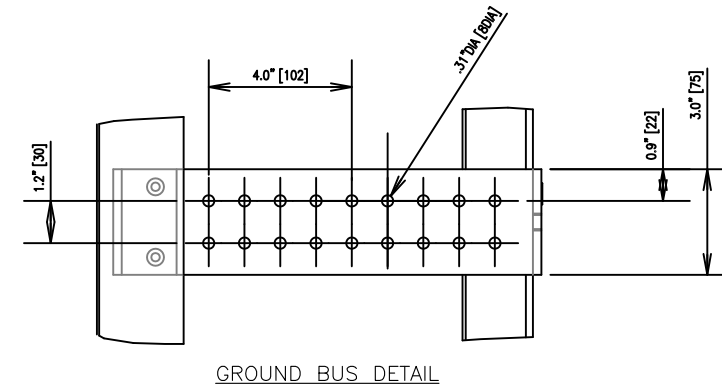

FOR QUOTE

Q0

JBT

DRAWN BY:
JBT

DATE
3/20/14

CHECKED BY

DATE

APPROVED BY

DATE

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.

TITLE: G9000 1000kVA UPS
OUTLINE & INSTALLATION DIAGRAM

SCALE
NTS

ORDER NO.

DRAWING NO.
1M441C14039KJBT-MKTG

TOSHIBA INTERNATIONAL CORPORATION
13131 WEST LITTLE YORK ROAD, HOUSTON, TX, 77041 U.S.A.

SH.2 OF 2